


UNIT OUTPUT MW

2.70  
2.60  
2.50  
2.40  
2.30  
2.20  
2.10  
2.00  
1.90  
1.80  
1.70  
1.60  
1.50  
1.40  
1.30  
1.20  
1.10  
1.00  
.90  
.80  
.70  
.60  
.50  
.40  
.30  
.20  
.10

ONE OF TWO UNITS  
ONE UNIT

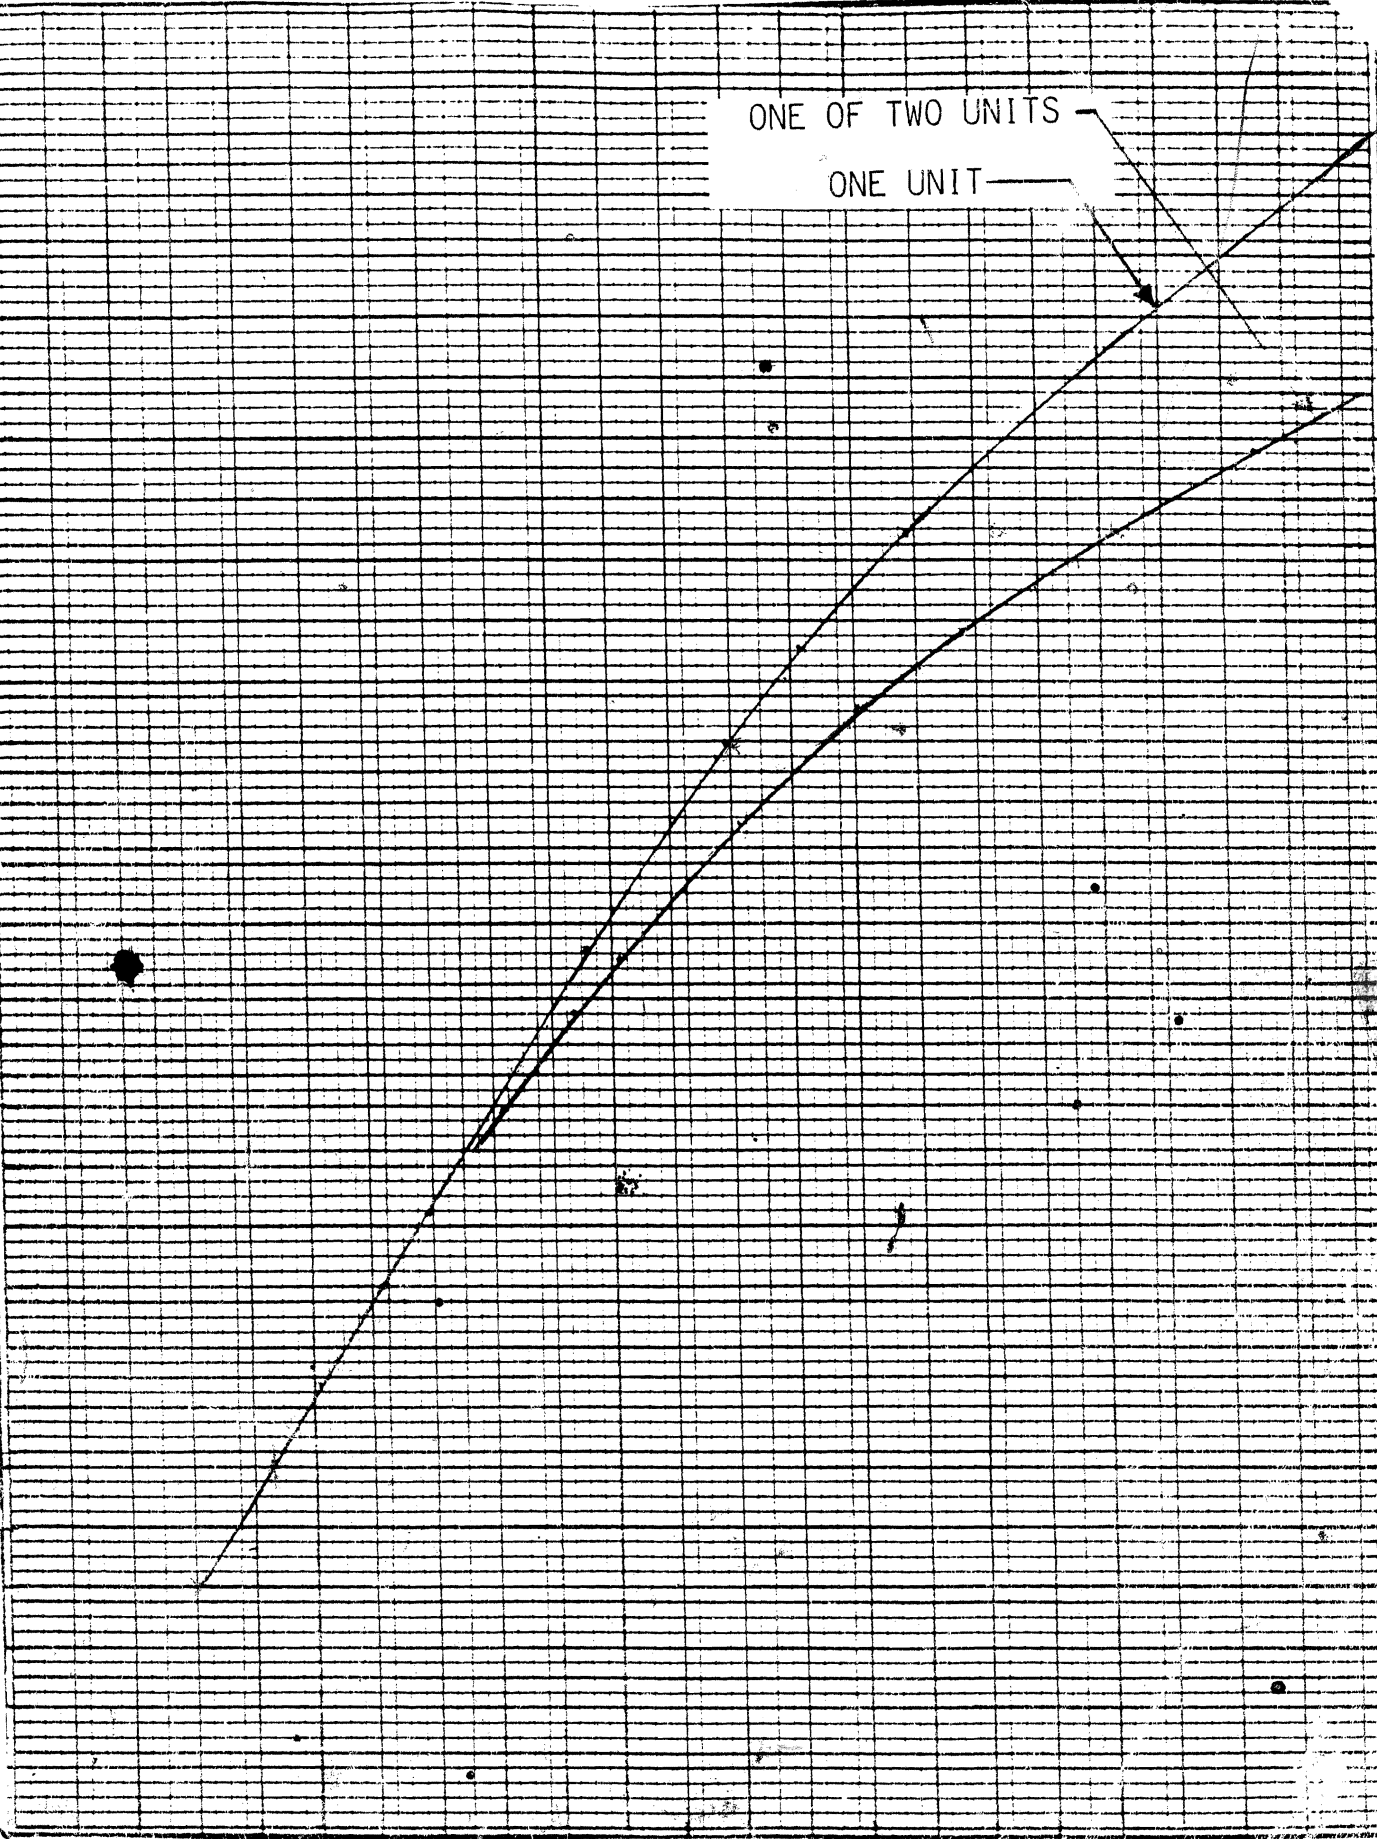

CFS

0 1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16 17 18 19 20 21 22

5 - 575      9 - 1050      13 - 1625

6 - 700      10 - 1175      14 - 1825

7 - 825      11 - 1300      15 - 2025

8 - 950      12 - 1450      16 - 2250

TURBINE DISCHARGE (cfs. x 100)  
WEST END DAM

4.440